


HYDRONIC HEATING PACKAGE SCHEDULE

SYMBOL	MANUFACTURER	GAS				CAPACITY, WATER				ELECTRICAL	
		MODEL	MBTU/HR INPUT (MAX/MIN)	MBTU/HR OUTPUT (MAX/MIN)	EFF	GPM	TDH	HWS	HMR		VOLTS/PH
IHM	FLOWTHERM SYSTEMS	CD1000FT	1000/50	978/49	97.7%	64	65'	160°F	130°F	460/60/3	11.4



PIPE SUPPORTS TO BE INSTALLED AS REQUIRED, SOME NOT SHOWN FOR CLARITY.

RELIEF VALVES AND SAFETY VALVES TO BE INSTALLED WITH LOCAL BE CODES AND ANY SEISMIC REQUIREMENT.


ALL BOLTS AND NUTS TO BE COMPLIANT WITH LOCAL BE CODES AND ANY SEISMIC REQUIREMENT.

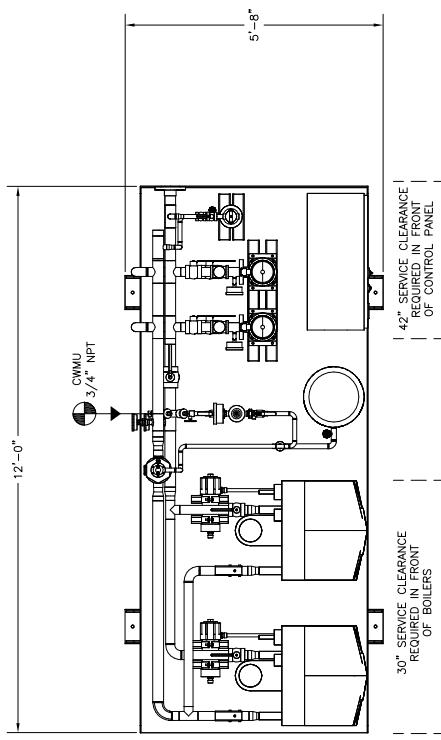

TOP VIEW

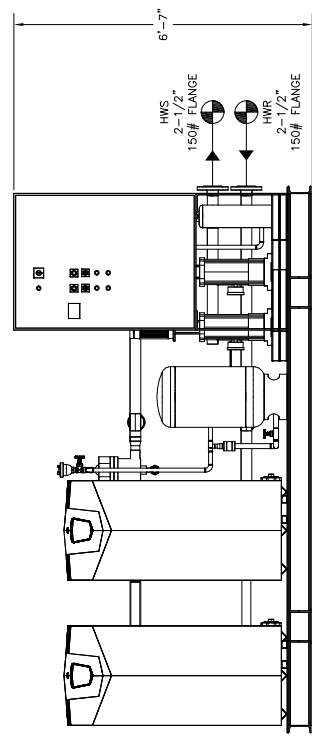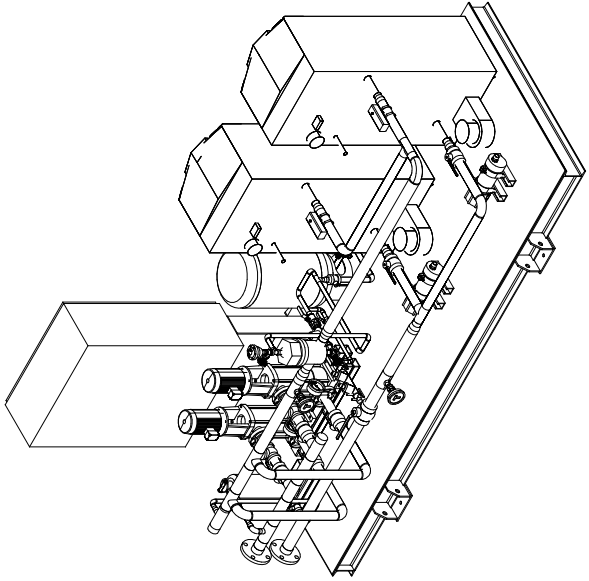

FRONT VIEW

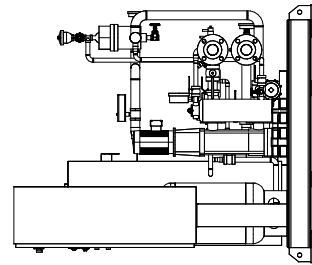

RIGHT END VIEW

DESIGN NOTES:
 (1) COMPLETE SYSTEM TO BE HYDRO TESTED TO 125 PSI PRIOR TO SHIPPING.
 (2) STEEL FRAME AND COMPONENTS TO RECEIVE TWO COATS OF GRAY MACHINE ENAMEL.
 (3) ALL WELDED WATER PIPING TO BE WELDED IN ACCORDANCE TO ASME B31.9
 (4) COMPLETE PACKAGE SYSTEM TO BE UL LISTED.
 = DENOTES CONTRACTOR POINT OF CONNECTION

UL LISTED
 PACKAGED PUMPING SYSTEMS
 HEAT TRANSFER SYSTEMS

APPROXIMATE SHIPPING WEIGHT: 3,640 LBS.
 APPROXIMATE OPERATING WEIGHT: 3,980 LBS.

THIS DRAWING AND THE INFORMATION IT CONTAINS ARE THE PROPERTY OF FLOWTHERM SYSTEMS. ALL RIGHTS ARE RESERVED. NO PART OF THIS DRAWING IS TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF FLOWTHERM SYSTEMS, INC.

JOB NAME:
 CONTRACTOR:
 DRAWING TITLE: HYDRONIC HEATING MODULE
 DRAWING No. IHM-231000FT

FlowTHERM Systems

REVISIONS:

REV	DATE	DESCRIPTION
A	08/08/17	ENGINEERING RELEASE