

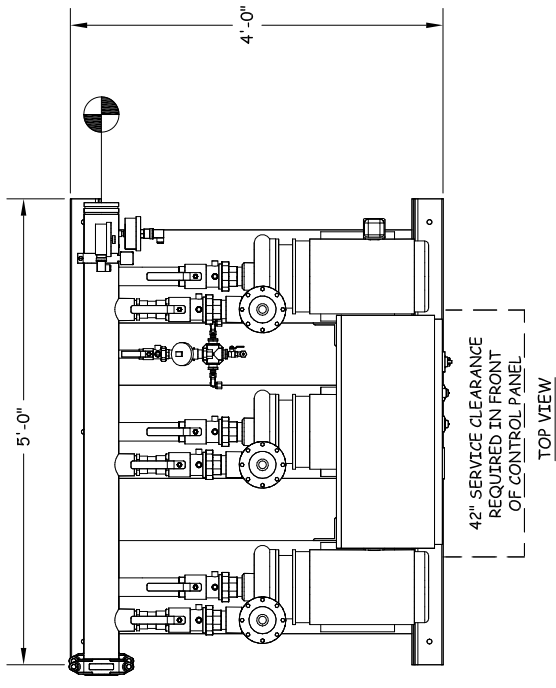
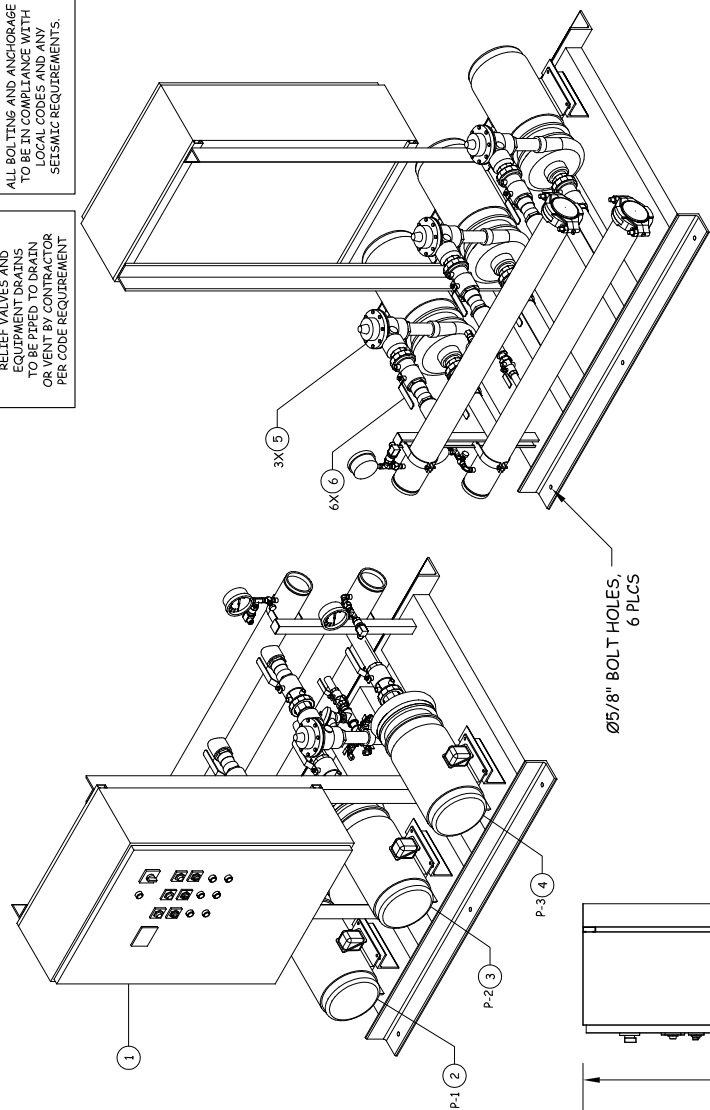


RELIEF VALVES AND EQUIPMENT DRAINS TO BE FIRED TO DRAIN OR TO ANCHORAGE PER CODE REQUIREMENT.

ALL BOLTING AND ANCHORAGE TO BE IN COMPLIANCE WITH LOCAL CODES AND ANY SEISMIC REQUIREMENTS.

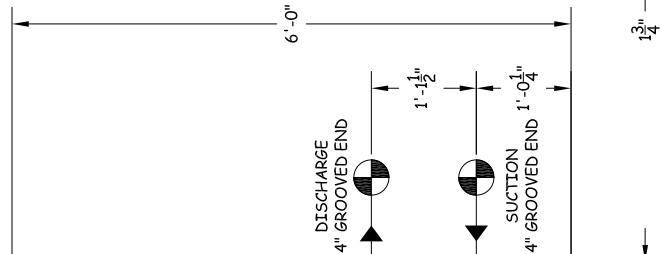

Ø5/8" BOLT HOLES, 6 PLCS

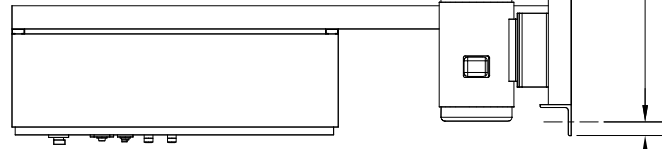

- GPM		- PSI		- PSI						
TOTAL FLOW		TOTAL DISCHARGE PRESSURE		AVAILABLE PRESSURE						
3	P-3	600LBS	11/2" X 2'-8"	-	10	3500	460 / 60 / 3	TEFC/P.E.		
2	P-2	600LBS	11/2" X 2'-8"	-	10	3500	460 / 60 / 3	TEFC/P.E.		
1	P-1	600LBS	11/2" X 2'-8"	-	10	3500	460 / 60 / 3	TEFC/P.E.		
ITEM	TAG	MANUFACTURER	SERIES	MODEL	GPM	TDH	HP	RPM	VOLTS/HZ/PH	ENCLOSURE

PUMP SCHEDULE

- GPM		- PSI		- PSI				
TOTAL FLOW		TOTAL DISCHARGE PRESSURE		AVAILABLE PRESSURE				
3	P-3	600LBS	11/2" X 2'-8"	-	10	3500	460 / 60 / 3	TEFC/P.E.
2	P-2	600LBS	11/2" X 2'-8"	-	10	3500	460 / 60 / 3	TEFC/P.E.
1	P-1	600LBS	11/2" X 2'-8"	-	10	3500	460 / 60 / 3	TEFC/P.E.

RIGHT END VIEW

FRONT VIEW

**GENERAL NOTES:**

- (1) SINGLE POINT POWER CONNECTION AT CONTROL PANEL.
- (2) HYDRO PRESSURE CHECK AT 125 PSI.
- (3) ASSEMBLED SYSTEM TO BE PAINTED WITH INDUSTRIAL MACHINE ENAMEL PRIOR TO SHIPMENT.

⊕ = DENOTES CONTRACTOR POINT OF CONNECTION

**UL LISTED**

PACKAGED PUMPING SYSTEMS & HEAT TRANSFER SYSTEMS

APPROXIMATE SHIPPING WEIGHT: 1,556 LBS

APPROXIMATE OPERATING WEIGHT: 1,645 LBS

PROJECT NAME: \_\_\_\_\_

CUSTOMER: \_\_\_\_\_

DRAWN BY DATE: \_\_\_\_\_ CHECKED BY: \_\_\_\_\_ APPROVED BY: \_\_\_\_\_

12/24/14

TOLERANCES UNLESS OTHERWISE SPECIFIED

DEC. .500" FRACTION 1/2" ANGLE 5° SCALE 1" = 1'-0"

**FLOWTHERM systems**

HAYWARD, CALIFORNIA

FEV3-9 VARIABLE SPEED TRIPLEX PRESSURE BOOSTER

DRAWING No. FEV3-9

REV A