




RELIEF VALVES AND EQUIPMENT DRAINS TO BE PIPED TO DRAIN OR VENT BY CONTRACTOR PER CODE REQUIREMENTS.

ALL BOLTING AND ANCHORAGE TO BE IN COMPLIANCE WITH LOCAL CODES AND ANY SEISMIC REQUIREMENTS.

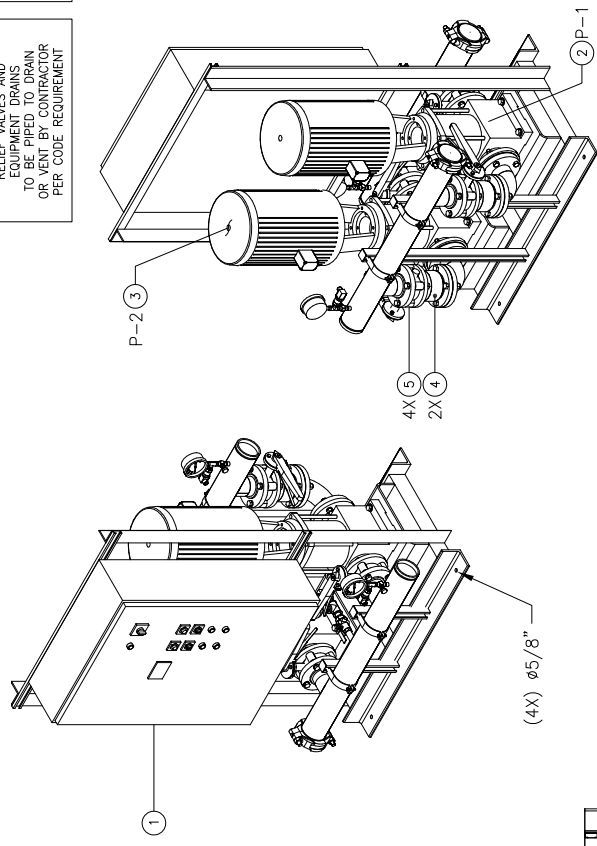

CONSTRUCTION NOTES:
 1. SUCTION AND DISCHARGE HEADERS ARE GROOVED ON BOTH ENDS.
 2. END CAPS CAN BE PLACED ON EITHER END OF HEADERS.
 3. SYSTEM DESIGNED FOR INDOOR INSTALLATION.

TOTAL FLOW		- PSI		- PSI		AVAILABLE PRESSURE	
TOTAL DISCHARGE PRESSURE		TOTAL SYSTEM CAPACITY					
3	P-2	60ULDS	ESV 46SVG-3/2	-	20	3500	460 / 60 / 3
2	P-1	60ULDS	ESV 46SVG-3/2	-	20	3500	460 / 60 / 3
ITEM	TAG	MANUFACTURER	SERIES	MODEL	GPM	TDH	HP
PUMP SCHEDULE							
10	-	-	-	-	-	-	-
9	-	-	-	-	-	-	-
8	-	-	-	-	-	-	-
7	-	-	-	-	-	-	-
6	-	-	-	-	-	-	-
5	4	-	-	-	-	-	-
4	2	-	-	-	-	-	-
3	1	P-2	GOULDS	ESV MULTISTAGE PUMP MODEL 46SVG-3/2			
2	1	P-1	GOULDS	ESV MULTISTAGE PUMP MODEL 46SVG-3/2			
1	1	-	-	AQUALOGIC XL CONTROL PANEL			
ITEM	QTY	TAG	DESCRIPTION				

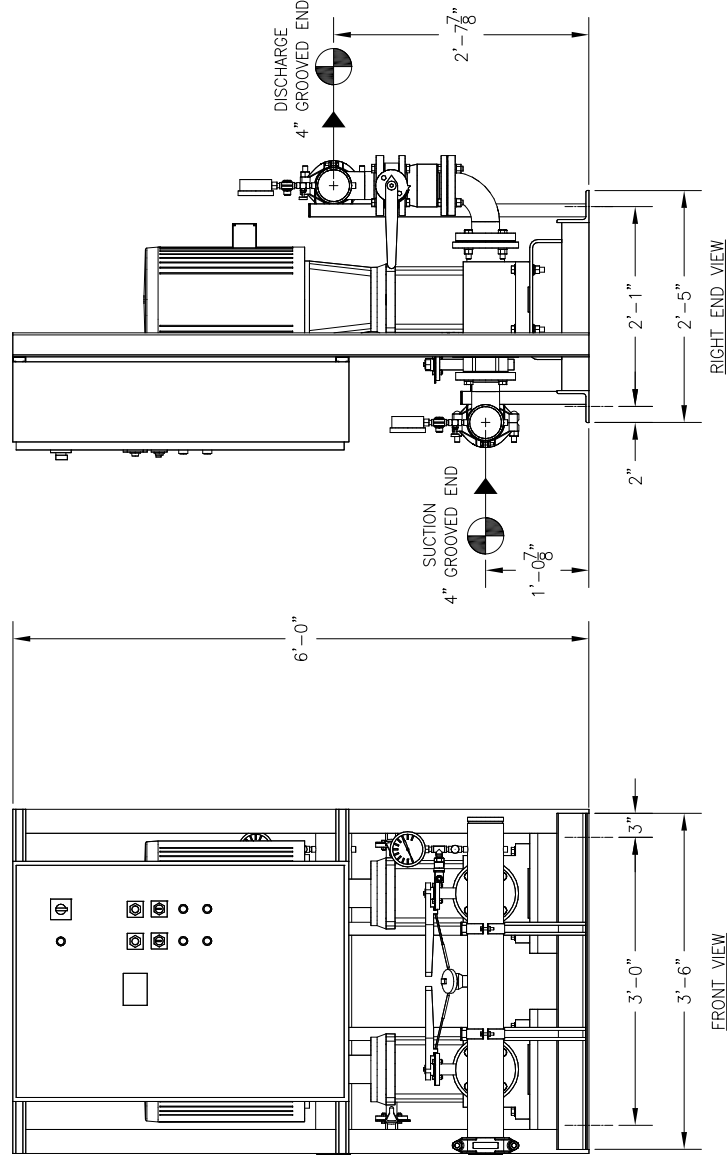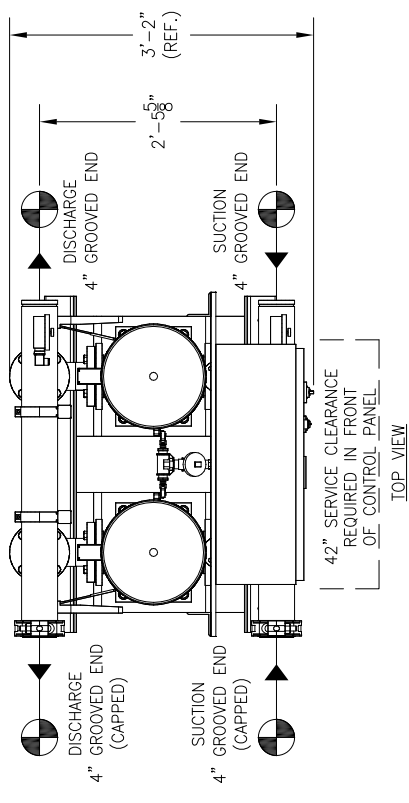

GENERAL NOTES:
 (1) SINGLE POINT POWER CONNECTION AT CONTROL PANEL.
 (2) HYDRO PRESSURE CHECK AT 125 PSI.
 (3) ASSEMBLED SYSTEM TO BE PAINTED WITH INDUSTRIAL MACHINE ENAMEL PRIOR TO SHIPMENT.

UL LISTED
 PACKAGED PUMPING SYSTEMS & HEAT TRANSFER SYSTEMS

APPROXIMATE SHIPPING WEIGHT: 1,816 LBS.
 APPROXIMATE OPERATING WEIGHT: 1,884 LBS.

PROJECT NAME: _____
CUSTOMER: _____
PROJECT NO.: _____
DRAWING NO.: FMW2.1-15-XL
REV.: 1

FLOWTECH systems
 HAYWARD, CALIFORNIA

EQUIPMENT SCHEDULE