





RELIEF VALVES AND ANCHORAGE EQUIPMENT DRAINS TO BE IN COMPLIANCE WITH LOCAL CODES AND ANY SEISMIC REQUIREMENTS.

RELIEF VALVES AND EQUIPMENT DRAINS TO BE PIPED TO DRAIN OR VENT BY CONTRACTOR PER CODE REQUIREMENT.

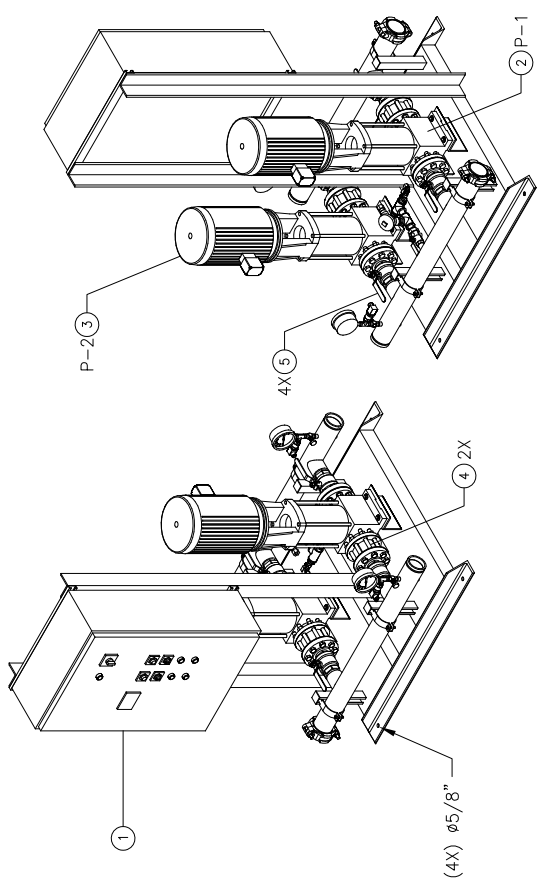

CONSTRUCTION NOTES:
 1. SUCTION AND DISCHARGE HEADERS ARE GROOVED ON BOTH ENDS.
 2. END CAPS CAN BE PLACED ON EITHER END OF HEADERS.
 3. SYSTEM DESIGNED FOR INDOOR INSTALLATION.

TOTAL FLOW		TOTAL DISCHARGE PRESSURE		TOTAL SYSTEM CAPACITY		AVAILABLE PRESSURE			
- GPM		- PSI		- PSI		- PSI			
3	P-2	60ULDS	ESV	15SVG-5	-	10	3500	H60 / 60 / 3	TEFC P.E.
2	P-1	60ULDS	ESV	15SVG-5	-	10	3500	H60 / 60 / 3	TEFC P.E.
ITEM	TAG	MANUFACTURER	SERIES	MODEL	GPM	HP	RPM	VOLTS/PH	ENCLOSURE
PUMP SCHEDULE									
10	-	-	-	-	-	-	-	-	-
9	-	-	-	-	-	-	-	-	-
8	-	-	-	-	-	-	-	-	-
7	-	-	-	-	-	-	-	-	-
6	-	-	-	-	-	-	-	-	-
5	4	-	-	-	-	-	-	-	BALL VALVE - 2"
4	2	-	-	-	-	-	-	-	VAL-MATIC WAFER CHECK VALVE - 2"
3	1	P-2	GOULDS	ESV MULTI-STAGE PUMP	MODEL 15SVG-5	-	-	-	-
2	1	P-1	GOULDS	ESV MULTI-STAGE PUMP	MODEL 15SVG-5	-	-	-	-
1	1	-	-	-	-	-	-	-	AQUALOGIC XL CONTROL PANEL
ITEM	QTY	TAG	DESCRIPTION						

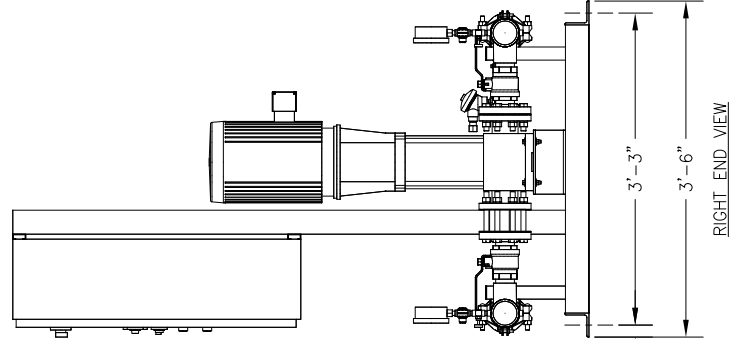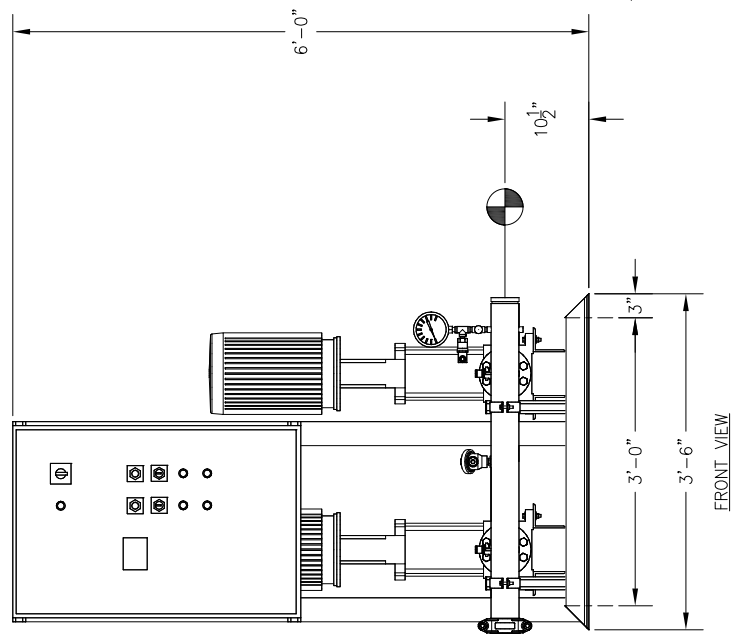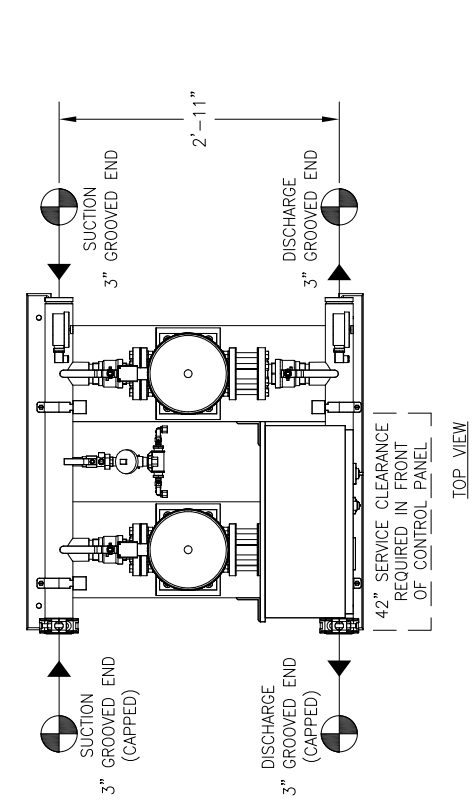

42" SERVICE CLEARANCE REQUIRED IN FRONT OF CONTROL PANEL

TOP VIEW

FRONT VIEW

RIGHT END VIEW

GENERAL NOTES:
 (1) SINGLE POINT POWER CONNECTION AT CONTROL PANEL.
 (2) HYDRO PRESSURE CHECK AT 125 PSI.
 (3) ASSEMBLED SYSTEM TO BE PAINTED WITH INDUSTRIAL MACHINE ENAMEL PRIOR TO SHIPMENT.

UL LISTED
 PACKAGED PUMPING SYSTEMS & HEAT TRANSFER SYSTEMS

APPROXIMATE SHIPPING WEIGHT: 959 LBS.
 APPROXIMATE OPERATING WEIGHT: 996 LBS.

PROJECT NAME:
 CUSTOMER:
 DRAWN BY DATE: 04/19/18
 CHECKED BY APPROVED BY:
 TOLERANCES UNLESS OTHERWISE SPECIFIED
 DEC. FRACTION: 1/2"
 ANGLE: 5°
 SCALE: 1" = 1'-0"

EQUIPMENT SCHEDULE

FLOWTECH systems
 HAYWARD, CALIFORNIA

DRAWING TITLE:
 FMW2.0-7-XL - VARIABLE SPEED DUPLEX PRESSURE BOOSTER

FAB NO. DRAWING NO. REV
 - - - - - FMW2.0-7-XL 1

= DENOTES CONTRACTOR POINT OF CONNECTION