

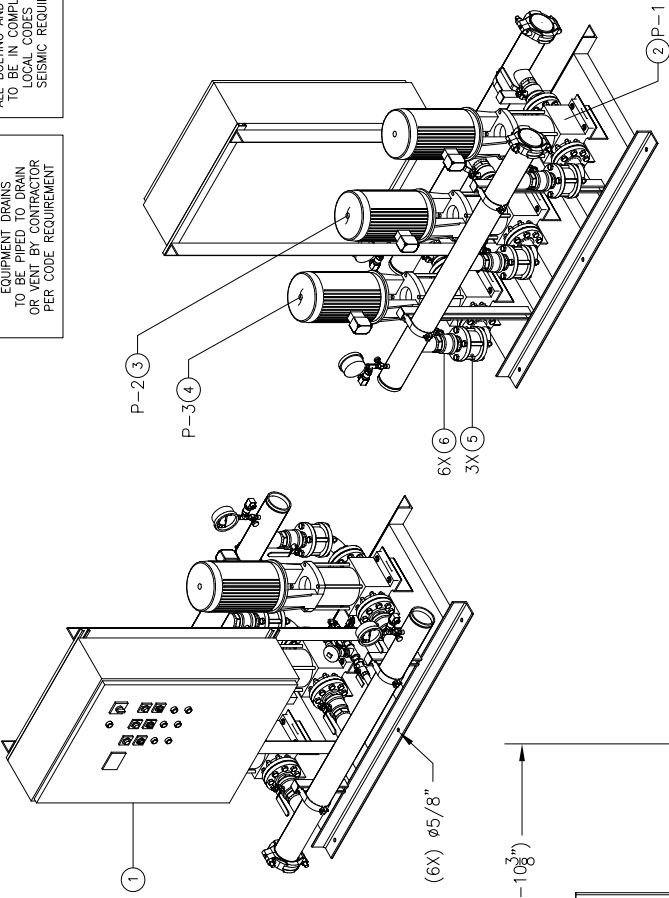


RELIEF VALVES AND ANCHORAGE TO BE IN COMPLIANCE WITH LOCAL CODES AND ANY SEISMIC REQUIREMENTS.

ALL BOLTING AND ANCHORAGE TO BE IN COMPLIANCE WITH LOCAL CODES AND ANY SEISMIC REQUIREMENTS.

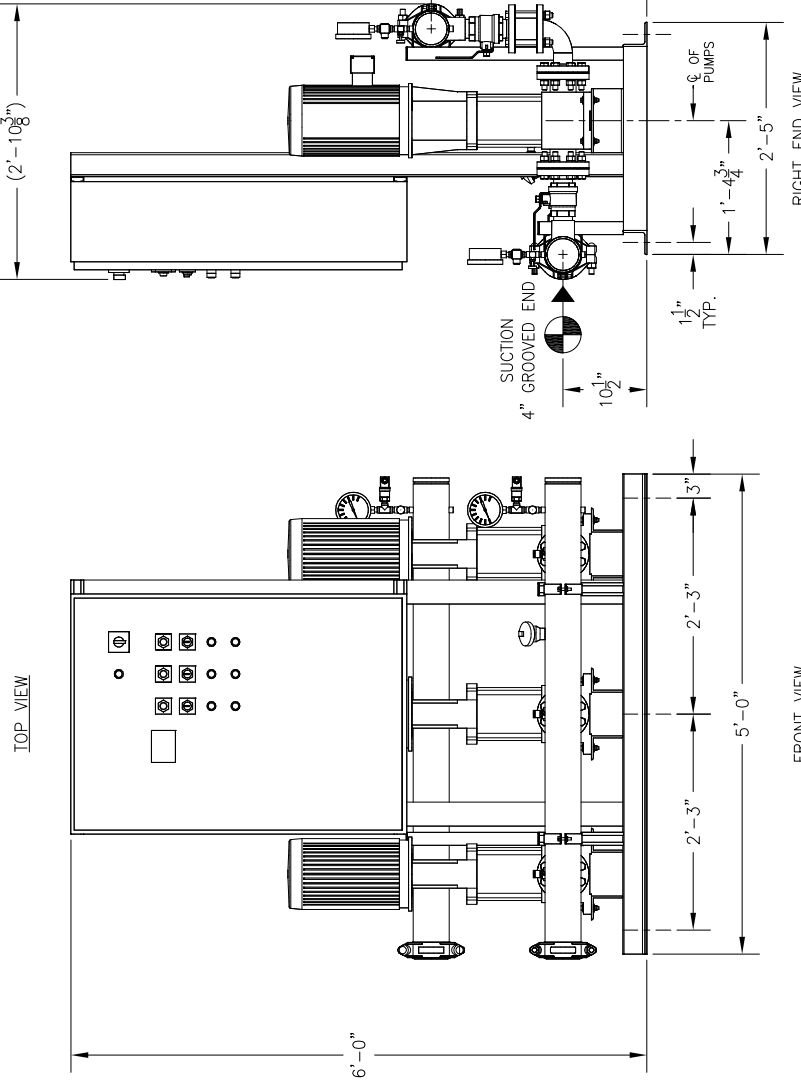

CONSTRUCTION NOTES:
 1. SUCTION AND DISCHARGE HEADERS ARE GROOVED ON BOTH ENDS.
 2. END CAPS CAN BE PLACED ON EITHER END OF HEADERS.
 3. SYSTEM DESIGNED FOR INDOOR INSTALLATION.

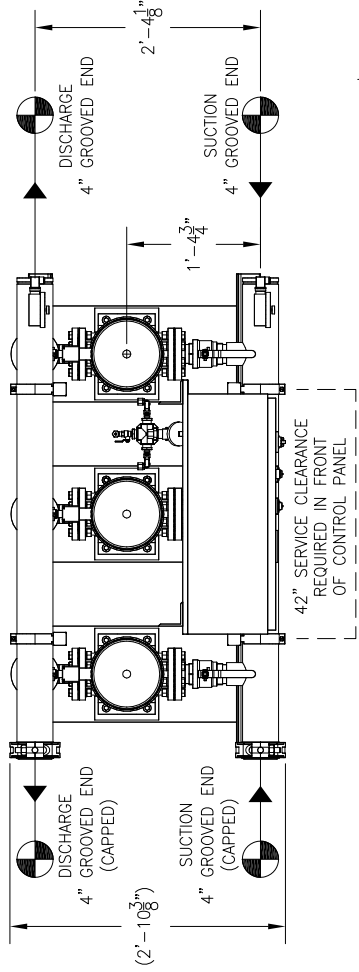

-GPM		-PSI		TOTAL SYSTEM CAPACITY									
TOTAL FLOW		TOTAL DISCHARGE PRESSURE		AVAILABLE PRESSURE									
4	P-3	60ULDS	ESV 155VG-4	-	7 1/2	3500	H60	/	60	/	3	TEFC	P.E.
3	P-2	60ULDS	ESV 155VG-4	-	7 1/2	3500	H60	/	60	/	3	TEFC	P.E.
2	P-1	60ULDS	ESV 155VG-4	-	7 1/2	3500	H60	/	60	/	3	TEFC	P.E.
ITEM	TAG	MANUFACTURER	SERIES	MODEL	GPM	TDH	HP	RPM	VOLTS/Hz/PH	ENCLOSURE			
PUMP SCHEDULE													
10	-	-	-	-	-	-	-	-	-	-			
9	-	-	-	-	-	-	-	-	-	-			
8	-	-	-	-	-	-	-	-	-	-			
7	-	-	-	-	-	-	-	-	-	-			
6	6	-	-	BALL VALVE	-	2"	-	-	-	-			
5	3	-	-	VAL-MATIC WAFER CHECK VALVE	-	2"	-	-	-	-			
4	1	P-3	GOULDS	ESV MULTI-STAGE PUMP	MODEL 155VG-4	-	-	-	-	-			
3	1	P-2	GOULDS	ESV MULTI-STAGE PUMP	MODEL 155VG-4	-	-	-	-	-			
2	1	P-1	GOULDS	ESV MULTI-STAGE PUMP	MODEL 155VG-4	-	-	-	-	-			
1	1	-	-	AQUALOGIC XL CONTROL PANEL	-	-	-	-	-	-			
ITEM	QTY	TAG	DESCRIPTION										

UL LISTED
 PACKAGED PUMPING SYSTEMS & HEAT TRANSFER SYSTEMS

APPROXIMATE SHIPPING WEIGHT: 1,151 LBS.
 APPROXIMATE OPERATING WEIGHT: 1,233 LBS.

GENERAL NOTES:
 (1) SINGLE POINT POWER CONNECTION AT CONTROL PANEL.
 (2) HYDRO PRESSURE CHECK AT 125 PSI.
 (3) ASSEMBLED SYSTEM TO BE PAINTED WITH INDUSTRIAL MACHINE ENAMEL PRIOR TO SHIPMENT.

PROJECT NAME: _____
 CUSTOMER: _____
 DRAWN BY DATE: _____
 CHECKED BY APPROVED BY: _____
 TOLERANCES UNLESS OTHERWISE SPECIFIED
 DEC. .500" 1/2" ANGLE 5" SCALE 1" = 1'-0"

EQUIPMENT SCHEDULE

FlowTHERM systems
 HAYWARD, CALIFORNIA

DRAWING TITLE: FMW3.1-6-XL - VARIABLE SPEED TRIPLEX PRESSURE BOOSTER
 DRAWING NO. FMW3.1-6-XL
 REV 1