

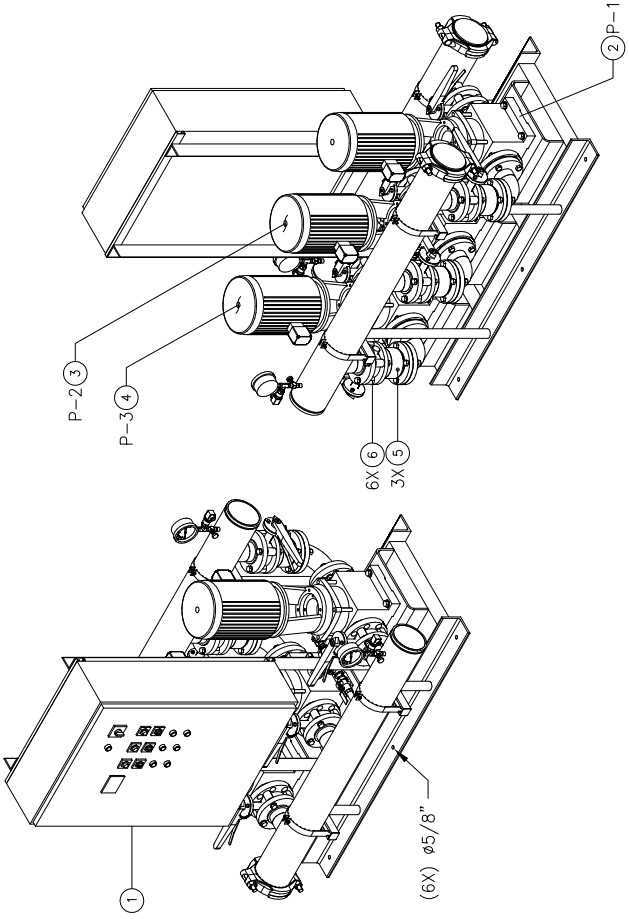


RELIEF VALVES AND ANCHORAGE EQUIPMENT DRAINS TO BE IN COMPLIANCE WITH LOCAL CODES AND ANY SEISMIC REQUIREMENTS.

RELIEF VALVES AND EQUIPMENT DRAINS TO BE PIPIED TO DRAIN OR VENT BY CONTRACTOR PER CODE REQUIREMENT

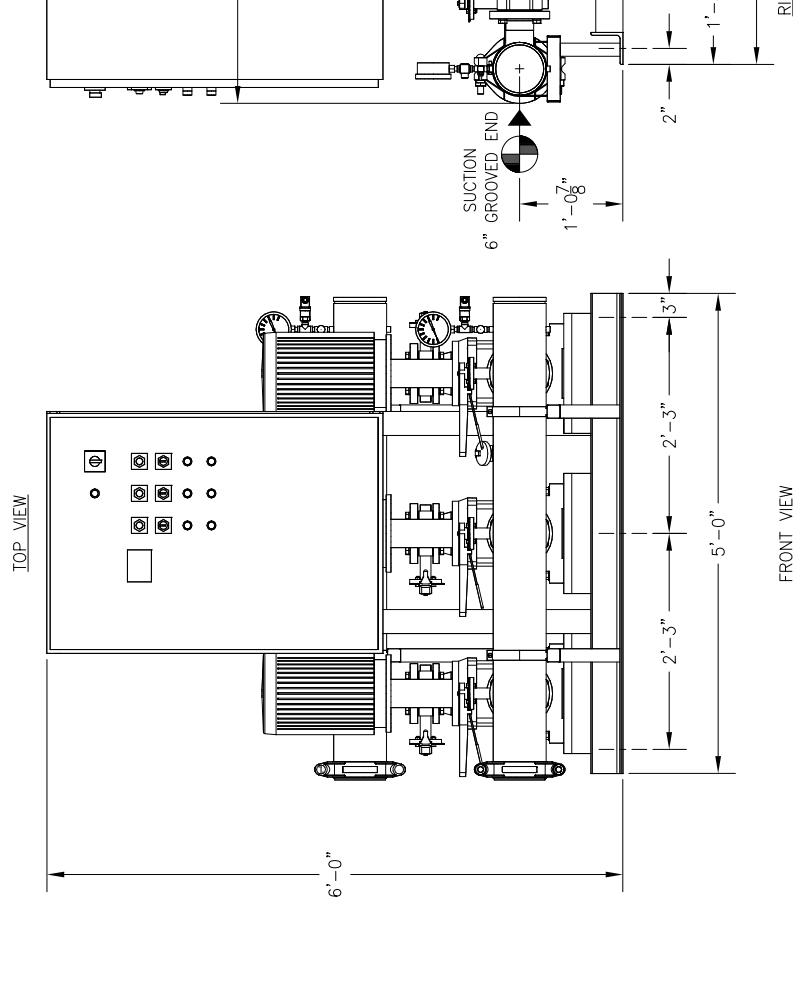

CONSTRUCTION NOTES:
 1. SUCTION AND DISCHARGE HEADERS ARE GROOVED ON BOTH ENDS.
 2. END CAPS CAN BE PLACED ON EITHER END OF HEADERS.
 3. SYSTEM DESIGNED FOR INDOOR INSTALLATION.

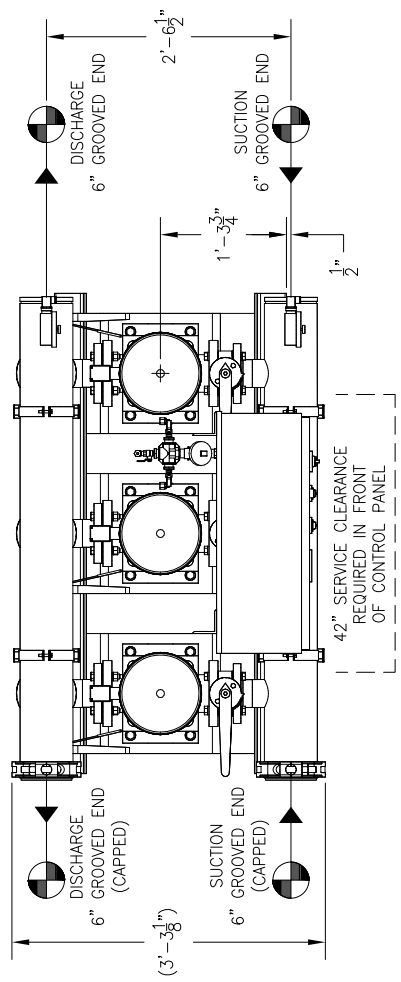

-GPM		-PSI		-PSI					
TOTAL FLOW		TOTAL DISCHARGE PRESSURE		AVAILABLE PRESSURE					
TOTAL SYSTEM CAPACITY									
4	P-3	GOULDS	ESV 46SVG-1	-	10				
3	P-2	GOULDS	ESV 46SVG-1	-	10				
2	P-1	GOULDS	ESV 46SVG-1	-	10				
ITEM	TAG	MANUFACTURER	SERIES	MODEL	TDH	HP	RPM	VOLTS/AHZ/PH	ENCLOSURE
PUMP SCHEDULE									
10	-	-	-	-	-	-	-	-	-
9	-	-	-	-	-	-	-	-	-
8	-	-	-	-	-	-	-	-	-
7	-	-	-	-	-	-	-	-	-
6	6	-	-	LUG TYPE BUTTERFLY VALVE	-	3"	-	-	-
5	3	-	-	VAL-MATIC GLOBE CHECK VALVE	-	3"	-	-	-
4	1	P-3	GOULDS	ESV MULTISTAGE PUMP MODEL 46SVG-1	-	-	-	-	-
3	1	P-2	GOULDS	ESV MULTISTAGE PUMP MODEL 46SVG-1	-	-	-	-	-
2	1	P-1	GOULDS	ESV MULTISTAGE PUMP MODEL 46SVG-1	-	-	-	-	-
1	1	-	-	AQUALOGIC XL CONTROL PANEL	-	-	-	-	-
ITEM	QTY	TAG	DESCRIPTION						

GENERAL NOTES:
 (1) SINGLE POINT POWER CONNECTION AT CONTROL PANEL.
 (2) HYDRO PRESSURE CHECK AT 125 PSI.
 (3) ASSEMBLED SYSTEM TO BE PAINTED WITH INDUSTRIAL MACHINE ENAMEL PRIOR TO SHIPMENT.

UL LISTED
 PACKAGED PUMPING SYSTEMS & HEAT TRANSFER SYSTEMS

APPROXIMATE SHIPPING WEIGHT: 2,003 LBS.
 APPROXIMATE OPERATING WEIGHT: 2,185 LBS.

PROJECT NAME: _____
CUSTOMER: _____
DRAWN BY DATE: _____
ACD 04/04/18
CHECKED BY APPROVED BY: _____
TOLERANCES UNLESS OTHERWISE SPECIFIED:
 DEC. .500" FRACTION 1/2" ANGLE 5" SCALE 1" = 1'-0"

EQUIPMENT SCHEDULE

FLOWTECH systems
 HAYWARD, CALIFORNIA

DRAWING TITLE: FMV3.1-13-XL - VARIABLE SPEED TRIPLEX PRESSURE BOOSTER
DRAWING NO.: FMV3.1-13-XL
FAB NO.: _____
REV: 1